

# ITS Dental Collage, Hospital & Research Center

## ETP Plant Report

Date	Power Consumption	Water Treated	PH	TDS	Dosing Pump (3)	Compressor	Primary Pump	Filter Feed Pump
1/8/24	176	2000	7-8	625	✓	✓	✓	✓
3/8/24	176	2000	7-8	625	✓	✓	✓	✓
5/8/24	176	2000	7-8	625	✓	✓	✓	✓
7/8/24	176	2000	7-8	625	✓	✓	✓	✓
9/8/24	176	2000	7-8	625	✓	✓	✓	✓
11/8/24	176	2000	7-8	625	✓	✓	✓	✓
13/8/24	176	2000	7-8	625	✓	✓	✓	✓
15/8/24	176	2000	7-8	625	✓	✓	✓	✓
17/8/24	176	2000	7-8	623	✓	✓	✓	✓
19/8/24	176	2000	7-8	625	✓	✓	✓	✓
23/8/24	176	2000	7-8	630	✓	✓	✓	✓
25/8/24	176	2000	7-8	630	✓	✓	✓	✓
27/8/24	176	2000	7-8	625	✓	✓	✓	✓
28/8/24	176	2000	7-8	620	✓	✓	✓	✓
29/8/24	176	2000	7-8	630	✓	✓	✓	✓
30/8/24	176	2000	7-8	630	✓	✓	✓	✓

*(Handwritten signature)*

*(Handwritten signature)*  
30/8/24

# ITS Dental Collage, Hospital & Research Center

## ETP Plant Report

Date	Power Consumption	Water Treated	PH	TDS	Dosing Pump (3)	Compressor	Primary Pump	Filter Feed Pump
1/9/24	176	2000	7.9	625	✓	✓	✓	✓
2/9/24	176	2000	7.9	625	✓	✓	✓	✓
5/9/24	176	2000	7.8	630	✓	✓	✓	✓
7/9/24	176	2000	7.8	630	✓	✓	✓	✓
10/9/24	176	2000	7.8	630	✓	✓	✓	✓
12/9/24	176	2000	8-9	630	✓	✓	✓	✓
13/9/24	176	2000	8-9	630	✓	✓	✓	✓
15/9/24	176	2000	8-9	630	✓	✓	✓	✓
17/9/24	176	2000	8-9	630	✓	✓	✓	✓
19/9/24	176	2000	8-9	630	✓	✓	✓	✓
21/9/24	176	2000	8-9	630	✓	✓	✓	✓
23/9/24	176	2000	8-9	630	✓	✓	✓	✓
25/9/24	176	2000	8-1	630	✓	✓	✓	✓
27/9/24	176	2000	8-9	630	✓	✓	✓	✓
29/9/24	176	2000	8-9	630	✓	✓	✓	✓
30/9/24	176	2000	8-9	630	✓	✓	✓	✓

*Handwritten signature*

*Handwritten signature*  
30/9/24

# ITS Dental Collage, Hospital & Research Center

## ETP Plant Report

Date	Power Consumption	Water Treated	PH	TDS	Dosing Pump (3)	Compressor	Primary Pump	Filter Feed Pump
1/10/24	176	2000	8-9	630	✓	✓	✓	✓
2/10/24	176	2000	8-9	630	✓	✓	✓	✓
5/10/24	176	2000	8-9	630	✓	✓	✓	✓
7/10/24	176	2000	8-9	630	✓	✓	✓	✓
9/10/24	176	2000	8-9	630	✓	✓	✓	✓
11/10/24	176	2000	8-9	630	✓	✓	✓	✓
12/10/24	176	2000	8-9	630	✓	✓	✓	✓
14/10/24	176	2000	8-9	630	✓	✓	✓	✓
16/10/24	176	2000	8-9	630	✓	✓	✓	✓
18/10/24	176	2000	8-9	630	✓	✓	✓	✓
22/10/24	176	2000	8-9	630	✓	✓	✓	✓
21/10/24	176	2000	8-9	630	✓	✓	✓	✓
23/10/24	176	2000	8-9	630	✓	✓	✓	✓
25/10/24	176	2000	8-9	630	✓	✓	✓	✓
28/10/24	176	2000	8-9	630	✓	✓	✓	✓
30/10/24	176	2000	8-9	630	✓	✓	✓	✓

Signature


30/10/24

# ITS Dental Collage, Hospital & Research Center

## ETP Plant Report

Date	Power Consumption	Water Treated	PH	TDS	Dosing Pump (3)	Compressor	Primary Pump	Filter Feed Pump
1/11/24	178	2000	8-9	630	✓	✓	✓	✓
3/11/24	178	2000	8-9	630	✓	✓	✓	✓
5/11/24	176	2000	8-9	630	✓	✓	✓	✓
7/11/24	176	2000	8-9	635	✓	✓	✓	✓
9/11/24	176	2000	8-9	635	✓	✓	✓	✓
11/11/24	176	2000	8-9	630	✓	✓	✓	✓
13/11/24	176	2000	8-9	630	✓	✓	✓	✓
15/11/24	176	2000	8-9	630	✓	✓	✓	✓
17/11/24	176	2000	8-9	628	✓	✓	✓	✓
19/11/24	176	2000	8-9	627	✓	✓	✓	✓
21/11/24	176	2000	8-9	620	✓	✓	✓	✓
23/11/24	176	2000	8-9	630	✓	✓	✓	✓
25/11/24	176	2000	8-9	628	✓	✓	✓	✓
29/11/24	176	2000	8-9	628	✓	✓	✓	✓
30/11/24	176	2000	8-9	630	✓	✓	✓	✓

प्रमुख अधिकारी

  
 30/11/24

# ITS Dental Collage, Hospital & Research Center

## ETP Plant Report

Date	Power Consumption	Water Treated	PH	TDS	Dosing Pump (3)	Compressor	Primary Pump	Filter Feed Pump
1/12/24	176	2000	8-9	630	✓	✓	✓	✓
3/12/24	176	2000	8-9	630	✓	✓	✓	✓
5/12/24	176	2000	8-9	630	✓	✓	✓	✓
7/12/24	176	2000	8-9	630	✓	✓	✓	✓
9/12/24	176	2000	8-9	630	✓	✓	✓	✓
11/12/24	176	2000	8-9	630	✓	✓	✓	✓
13/12/24	176	2000	8-9	630	✓	✓	✓	✓
15/12/24	176	2000	8-9	630	✓	✓	✓	✓
17/12/24	176	2000	8-9	630	✓	✓	✓	✓
19/12/24	176	2000	8-9	620	✓	✓	✓	✓
21/12/24	176	2000	8-9	625	✓	✓	✓	✓
23/12/24	176	2000	8-9	630	✓	✓	✓	✓
25/12/24	176	2000	8-9	634	✓	✓	✓	✓
27/12/24	176	2000	8-9	630	✓	✓	✓	✓
29/12/24	176	2000	8-9	635	✓	✓	✓	✓
31/12/24	176	2000	8-9	630	✓	✓	✓	✓

*Handwritten signature*

*Handwritten signature*  
30/12/24

## ETP Plant Report

Date	Power Consumption	Water Treated	PH	TDS	Dosing Pump(3)	Compressor	Primary Pump	Filter Feed Pump
11/7/24	176	2000	8-7	630	✓	✓	✓	✓
2/7/24	176	2000	8-7	630	✓	✓	✓	✓
			<del>8-7</del>					
3/7/24	176	2000	8-7	630	✓	✓	✓	✓
4/7/24	176	2000	8-7	635	✓	✓	✓	✓
5/7/24	176	2000	8-2	625	✓	✓	✓	✓
6/7/24	176	2000	8-7	630	✓	✓	✓	✓
7/7/24	176	2000	8-7	630	✓	✓	✓	✓
8/7/24	176	2000	8-7	635	✓	✓	✓	✓
9/7/24	176	2000	8-7	635	✓	✓	✓	✓
10/7/24	176	2000	8-7	635	✓	✓	✓	✓
12/7/24	176	2000	8-9	625	✓	✓	✓	✓
15/7/24	176	2000	8-9	625	✓	✓	✓	✓
17/7/24	176	2000	8-9	635	✓	✓	✓	✓
18/7/24	176	2000	8-9	635	✓	✓	✓	✓
20/7/24	176	2000	8-9	635	✓	✓	✓	✓
21/7/24	176	2000	8-9	635	✓	✓	✓	✓
22/7/24	176	2000	8-9	635	✓	✓	✓	✓
23/7/24	176	2000	8-9	635	✓	✓	✓	✓
24/7/24	176	2000	8-9	625	✓	✓	✓	✓
25/7/24	176	2000	8-9	625	✓	✓	✓	✓
26/7/24	176	2000	8-9	625	✓	✓	✓	✓
27/7/24	176	2000	8-9	625	✓	✓	✓	✓
28/7/24	176	2000	8-9	625	✓	✓	✓	✓
29/7/24	176	2000	8-9	635	✓	✓	✓	✓
30/7/24	176	2000	8-9	630	✓	✓	✓	✓
31/7/24	176	2000	8-9	630	✓	✓	✓	✓

ymj/24







ETP Plant Report

Date	Power Consumption	Water Treated	PH	TDS	Dosing Pump(3)	Compressor	Primary Pump	Filter Feed Pump
11/4/24	178	2000	8-7	620	✓	✓	✓	✓
21/4/24	178	2000	8-7	620	✓	✓	✓	✓
31/4/24	178	2000	8-7	620	✓	✓	✓	✓
6/4/24	178	2000	8-7	625	✓	✓	✓	✓
7/4/24	178	2000	8-7	625	✓	✓	✓	✓
8/4/24	178	2000	8-7	630	✓	✓	✓	✓
9/4/24	178	2000	8-7	630	✓	✓	✓	✓
11/4/24	178	2000	8-7	625	✓	✓	✓	✓
13/4/24	178	2000	8-7	625	✓	✓	✓	✓
15/4/24	178	2000	8-7	625	✓	✓	✓	✓
16/4/24	178	2000	8-7	625	✓	✓	✓	✓
18/4/24	178	2000	8-7	620	✓	✓	✓	✓
20/4/24	178	2000	8-7	630	✓	✓	✓	✓
22/4/24	178	2000	8-7	630	✓	✓	✓	✓
25/4/24	128	2000	8-7	630	✓	✓	✓	✓
28/4/24	128	2000	8-7	635	✓	✓	✓	✓
30/4/24	178	2000	8-7	630	✓	✓	✓	✓

All pumps working fine  
 30/4/24

30/4/24

M/S Smt. Smt.

March 2024

ITS Dental Collage , Grater Noida  
ETP Plant Report

Date	Power Consumption	Water Treated	PH	TDS	Dosing Pump(3)	Compressor	Primary Pump	Filter Feed Pump
1/3/24	176	2000	8-7	620	✓	✓	✓	✓
2/3/24	176	2000	8-7	625	✓	✓	✓	✓
3/3/24	176	2000	8-7	625	✓	✓	✓	✓
5/3/24	178	2000	8-7	625	✓	✓	✓	✓
7/3/24	178	2000	8-8	622	✓	✓	✓	✓
9/3/24	178	2000	8-7	622	✓	✓	✓	✓
11/3/24	178	2000	8-9	622	✓	✓	✓	✓
12/3/24	178	2000	8-9	620	✓	✓	✓	✓
15/3/24	178	2000	8-9	620	✓	✓	✓	✓
16/3/24	178	2000	8-9	620	✓	✓	✓	✓
18/3/24	176	2000	8-9	620	✓	✓	✓	✓
19/3/24	176	2000	8-9	620	✓	✓	✓	✓
20/3/24	176	2000	8-9	622	✓	✓	✓	✓
22/3/24	176	2000	8-9	625	✓	✓	✓	✓
23/3/24	176	2000	8-9	625	✓	✓	✓	✓
24/3/24	176	2000	8-7	624	✓	✓	✓	✓
26/3/24	176	2000	8-7	620	✓	✓	✓	✓
28/3/24	176	2000	8-7	626	✓	✓	✓	✓
30/3/24	176	2000	8-7	620	✓	✓	✓	✓
31/3/24	176	2000	8-7	625	✓	✓	✓	✓

Handwritten signature and date: 31/3/24

Handwritten signature

Feb - 2024

ITS Dental Collage , Grater Noida  
ETP Plant Report

Date	Power Consumption	Water Treated	PH	TDS	Dosing Pump(3)	Compressor	Primary Pump	Filter Feed Pump
11/2/24	176	2000	8-7	622	✓	✓	✓	✓
4/2/24	176	2000	8-7	620	✓	✓	✓	✓
6/2/24	178	2000	8-9	620	✓	✓	✓	✓
8/2/24	178	2000	8-9	646	✓	✓	✓	✓
10/2/24	178	2000	8-9	615	✓	✓	✓	✓
12/2/24	176	2000	8-9	620	✓	✓	✓	✓
15/2/24	176	2000	8-7	628	✓	✓	✓	✓
18/2/24	176	2000	8-7	620	✓	✓	✓	✓
20/2/24	176	2000	8-7	620	✓	✓	✓	✓
22/2/24	176	2000	8-7	620	✓	✓	✓	✓
26/2/24	176	2000	8-7	625	✓	✓	✓	✓
28/2/24	178	2000	8-7	620	✓	✓	✓	✓
29/2/24	177	2000	8-7	620	✓	✓	✓	✓

All data checked & correct

Signature  
29/2/24

Ymk 3/11

ITS Dental Collage , Grater Noida

June 24 - 2024

ETP Plant Report

Date	Power Consumption	Water Treated	PH	TDS	Dosing Pump(3)	Compressor	Primary Pump	Filter Feed Pump
1/1/24	176-	2000	8-7	622	✓	✓	✓	✓
2/1/24	178	1500	8-7	623	✓	✓	✓	✓
4/1/24	178	2000	8-8	624	✓	✓	✓	✓
6/1/24	178	2000	8-8	625	✓	✓	✓	✓
7/1/24	178	3000	8-8	624	✓	✓	✓	✓
9/1/23	176	2000	8-8	623	✓	✓	✓	✓
11/1/24	176	2000	8-8	625	✓	✓	✓	✓
12/1/24	176	2000	8-8	622	✓	✓	✓	✓
13/1/24	176	2000	8-8	624	✓	✓	✓	✓
14/1/24	176	2000	8-8	624	✓	✓	✓	✓
15/1/24	176	2000	8-8	624	✓	✓	✓	✓
16/1/24	176	2000	8-8	624	✓	✓	✓	✓
18/1/24	176	2000	8-8	624	✓	✓	✓	✓
19/1/24	176	2000	8-7	624	✓	✓	✓	✓
20/1/24	176	2000	8-7	624	✓	✓	✓	✓
21/1/24	176	2000	8-8	624	✓	✓	✓	✓
22/1/24	176	2000	8-8	624	✓	✓	✓	✓
23/1/24	176	2000	8-7	624	✓	✓	✓	✓
24/1/24	176	2000	8-7	624	✓	✓	✓	✓
25/1/24	176	2000	8-7	624	✓	✓	✓	✓
26/1/24	176	2000	8-7	625	✓	✓	✓	✓
27/1/24	176	2000	8-8	623	✓	✓	✓	✓
29/1/24	176	2000	8-8	623	✓	✓	✓	✓
30/1/24	176	2000	8-8	623	✓	✓	✓	✓
31/1/24	176	2000	8-9	625	✓	✓	✓	✓

All parameters are within range.  
 31/1/24



NOVEMBER -

ITS Dental Collage, Grater Noida

NOVEMBER - 2023.

ETP Plant Report

Date	Power Consumption	Water Treated	PH	TDS	Dosing Pump(3)	Compressor	Primary Pump	Filter Feed Pump
1-11-23	17.8	2000	8.6	614	✓	✓	✓	✓
3-11-23	17.8	2000	8.5	615	✓	✓	✓	✓
5-11-23	17.8	2000	8.7	618	✓	✓	✓	✓
5-11-23	17.8	4000	8.7	623	✓	✓	✓	✓
7-11-23	17.8	2000	8.7	618	✓	✓	✓	✓
9-11-23	17.8	1500	8.7	618	✓	✓	✓	✓
11-11-23	17.8	2000	8.7	618	✓	✓	✓	✓
13-11-23	17.8	2000	8.7	618	✓	✓	✓	✓
15-11-23	17.8	2000	8.7	614	✓	✓	✓	✓
17-11-23	17.8	2000	8.7	613	✓	✓	✓	✓
19-11-23	17.8	2000	8.7	612	✓	✓	✓	✓
21-11-23	17.8	2000	8.7	610	✓	✓	✓	✓
23-11-23	17.8	2000	8.7	511	✓	✓	✓	✓
24-11-23	17.8	3000	8.7	612	✓	✓	✓	✓
26-11-23	17.8	2000	8.7	612	✓	✓	✓	✓
28-11-23	17.8	2000	8.7	614	✓	✓	✓	✓
30-11-23	17.8	2000	8.7	612	✓	✓	✓	✓

~~Handwritten signature and scribbles~~

Handwritten notes and dates on the right margin, including "30/11".



ITS Dental Collage , Grater Noida    **SEPTEMBER-2023**  
ETP Plant Report

Date	Power Consumption	Water Treated	PH	TDS	Dosing Pump(3)	Compressor	Primary Pump	Filter Feed Pump
1-9-23	176	2000	8.7	614	✓	✓	✓	✓
3-9-23	176	2000	8.7	614	✓	✓	✓	✓
5-9-23	177	2000	8.7	614	✓	✓	✓	✓
7-9-23	178	2000	8.7	614	✓	✓	✓	✓
9-9-23	178	2000	8.7	614	✓	✓	✓	✓
11-9-23	178	3000	8.7	614	✓	✓	✓	✓
13-9-23	178	2000	8.7	614	✓	✓	✓	✓
15-9-23	178	2000	8.7	614	✓	✓	✓	✓
17-9-23	178	3000	8.7	614	✓	✓	✓	✓
19-9-23	178	2000	8.7	613	✓	✓	✓	✓
21-9-23	178	2000	8.7	614	✓	✓	✓	✓
23-9-23	178	2000	8.7	614	✓	✓	✓	✓
25-9-23	178	2000	8.7	614	✓	✓	✓	✓
27-9-23	178	2000	8.7	614	✓	✓	✓	✓
29-9-23	178	2000	8.7	614	✓	✓	✓	✓
30-9-23	178	2000	8.7	614	✓	✓	✓	✓
<i>Yash Jaiswal</i>								

9.5  
 30/9/23



ITS Dental Collage , Grater Noida  
ETP Plant Report

August - 2023

Date	Power Consumption	Water Treated	PH	TDS	Dosing Pump(3)	Compressor	Primary Pump	Filter Feed Pump
1-8-23	178	2000	8.7	614	✓	✓	✓	✓
3-8-23	178	2000	8.7	615	✓	✓	✓	✓
5-8-23	178	3000	8.7	614	✓	✓	✓	✓
7-8-23	178	3000	8.7	614	✓	✓	✓	✓
9-8-23	178	2000	8.7	611	✓	✓	✓	✓
11-8-23	178	2000	8.7	611	✓	✓	✓	✓
13-8-23	178	3000	8.7	612	✓	✓	✓	✓
15-8-23	178	3000	8.7	620	✓	✓	✓	✓
17-8-23	178	2000	8.7	621	✓	✓	✓	✓
19-8-23	178	2000	8.7	622	✓	✓	✓	✓
21-8-23	178	2000	8.7	622	✓	✓	✓	✓
23-8-23	178	2000	8.7	613	✓	✓	✓	✓
25-8-23	178	2000	8.7	622	✓	✓	✓	✓
27-8-23	178	2000	8.7	623	✓	✓	✓	✓
29-8-23	178	3000	8.7	622	✓	✓	✓	✓
30-8-23	178	2000	8.7	620	✓	✓	✓	✓

YHS JMC

30/8/23



ITS Dental Collage , Grater Noida  
ETP Plant Report

JUN - 2023

Date	Power Consumption	Water Treated	PH	TDS	Dosing Pump(3)	Compressor	Primary Pump	Filter Feed Pump
1/6/23	1765	2000	8-7	590	✓	✓	✓	✓
3/6/23	176-0	2000	8-7	612	✓	✓	✓	✓
5/6/23	176-6	2000	8-7	613	✓	✓	✓	✓
7/6/23	178-0	3000	8-7	614	✓	✓	✓	✓
9/6/23	177-0	2000	8-7	615	✓	✓	✓	✓
11/6/23	178-0	3000	8-7	614	✓	✓	✓	✓
12/6/23	178-	2000	8-7	614	✓	✓	✓	✓
14/6/23	178	2000	8-7	613	✓	✓	✓	✓
16/6/23	177	3000	8-7	612	✓	✓	✓	✓
18/6/23	176	2000	8-7	614	✓	✓	✓	✓
20/6/23	175	2000	8-7	614	✓	✓	✓	✓
22/6/23	178	3000	8-7	614	✓	✓	✓	✓
24/6/23	178	2000	8-7	614	✓	✓	✓	✓
26/6/23	178	1500	8-7	614	✓	✓	✓	✓
28/6/23	178	3000	8-7	615	✓	✓	✓	✓
30/6/23	178	2000	8-7	614	✓	✓	✓	✓

Handwritten signature/initials

Vertical handwritten notes on the right side of the table.

Handwritten signature and date: 30/6/23

May-2023

ITS Dental Collage , Grater Noida

ETP Plant Report MAY 2023

Date	Power Consumption	Water Treated	PH	TDS	Dosing Pump(3)	Compressor	Primary Pump	Filter Feed Pump
1-5-23	166	6000	8.0	567	✓	✓	✓	✓
3-5-23	160	6500	8.5	570	✓	✓	✓	✓
5-5-23	162	6200	8.7	565	✓	✓	✓	✓
7-5-23	160	5500	8.0	568	✓	✓	✓	✓
9-5-23	166	5000	8.3	560	✓	✓	✓	✓
11-5-23	170	4500	7.9	565	✓	✓	✓	✓
13-5-23	165	4000	7.5	566	✓	✓	✓	✓
15-5-23	170	4500	8.0	568	✓	✓	✓	✓
17-5-23	171	5000	8.1	570	✓	✓	✓	✓
19-5-23	160	5500	8.3	565	✓	✓	✓	✓
21-5-23	162	5000	8.5	555	✓	✓	✓	✓
23-5-23	162	5500	8.2	560	✓	✓	✓	✓
25-5-23	164	5000	8.6	565	✓	✓	✓	✓
27-5-23	165	4500	8.3	568	✓	✓	✓	✓
29-5-23	161	4000	8.5	570	✓	✓	✓	✓
31-5-23	160	4500	8.0	535	✓	✓	✓	✓
		5						

*Handwritten signature/initials*

*Vertical handwritten notes on the right side of the table, including checkmarks and scribbles.*

April-2023

ITS Dental Collage , Grater Noida

ETP Plant Report APRIL 2023

Date	Power Consumption	Water Treated	PH	TDS	Dosing Pump(3)	Compressor	Primary Pump	Filter Feed Pump
1-4-23	165	6000	8.0	566	✓	✓	✓	✓
3-4-23	166	6500	8.1	568	✓	✓	✓	✓
5-4-23	168	6800	8.3	570	✓	✓	✓	✓
7-4-23	170	6500	8.5	572	✓	✓	✓	✓
9-4-23	171	6000	8.0	560	✓	✓	✓	✓
11-4-23	162	6500	8.3	566	✓	✓	✓	✓
13-4-23	166	5500	8.0	555	✓	✓	✓	✓
15-4-23	165	5000	8.7	560	✓	✓	✓	✓
17-4-23	168	4500	8.5	562	✓	✓	✓	✓
19-4-23	166	4000	8.0	566	✓	✓	✓	✓
21-4-23	168	3500	7.9	555	✓	✓	✓	✓
23-4-23	170	4000	7.5	550	✓	✓	✓	✓
25-4-23	171	4500	8.3	560	✓	✓	✓	✓
27-4-23	172	5000	8.5	561	✓	✓	✓	✓
29-4-23	160	5500	8.6	570	✓	✓	✓	✓
30-4-23	165	6000	8.5	560	✓	✓	✓	✓

*gandhi*

*de*

**FORM 1**  
**CONSENT SEEKING FORM**

(To be submitted in triplicate)

Application for consent for discharge/continuation of discharge under section 25/26 of the Act

(See RULE 3)

Date- 19/09/2020

From ,

I T S DENTAL COLLEGE HOSPITAL AND RESEARCH CENTRE, ITS DENTAL COLLEGE  
HOSPITAL RESEARCH CENTRE, PLOT NO.47, KNOWLEDGE PARK III, GREATER  
NOIDA,GAUTAM BUDH NAGAR,201308

City:GREATER NOIDA

Block:Dadri

District:GREATER NOIDA

To ,

The Member Secretary,

U. P. Pollution Control Board

Lucknow.

Sir,

I/We apply for CONSENT under section 25/26 fo the Water (Prevention and Control of Pollution) Act, 1974 (Act no VI of 1974) to bring into use any\* new or altered outlet for the discharge of sewage/trade effluent\* to begin to make new discharge of sewage/trade effluent or \*Continue to make discharge of sewage/trade effluent from land/premises owned by (1) RAMPRAKASH CHADHA for a period upto (2).4 years

1. Disposal of Liquid/Solid Waste:-

(a). Sewage/Sullage via drains/outfall sewers/treatment works.

(b). Trade effluent via drains/outfalls sewers/treatment works

Surrounding of Site	Distance (in meters)	Description
---------------------	----------------------	-------------

2. The annexure, appendices other particulars and plans in triplicate are attached herewith.

3. I/We further declare that the information furnished in the Annexure, appendices and plans is correct to the best of my/our knowledge.

4. I/We hereby submit that in case of change either of the point or the quantity of discharge or its quality, a fresh application for CONSENT shall be made and until such CONSENT is granted no change shall be made.

5. I /We hereby agree to submit to the Board and application for renewal of consent one month in advance of the date of expiry of the consented period for outlet/discharge, if to be continued thereafter.

6. I/We undertake to furnish other information within one month of its being called by the Board.

**Accompaniments:-**

1. water report (Attached)

2. Report showing project cost (Attached)

Yours faithfully,

Signature ,  
Name of Applicant:- RAMPRAKASH CHADHA  
Address of applicant:- PLOT NO 47,  
KNOWLEDGE PARK III, GREATER NOIDA

\*Note:- Strike out entries not relevant.

## ANNEXURE TO FORM

### New Outlet

NOTE- Any applicant knowingly giving incorrect information or suppressing any information pertaining thereto shall be liable to be punished under the Act.

While filling this Annexure the applicant not concerned with any of the item shall state 'No concerned' against the relevant one:

7. Is the industry/factory for which application is made closed on Sunday/Holiday Yes
8. State working days per year and working season for the industry/factory Jan to Jan
9. a) Number of workers attending the factory shift wise &/ or per day : 200  
b) Number of workers residing in the premises : 200
10. For local bodies only:-  
a) Present population : NA  
b) Population covered under regular sewer facilities : NA  
c) population having septic tank/Soak pit facilities : NA  
d) Population covered by conservancy latrines : NA
11. For Industries Only:-

A. Give the list of raw materials

Raw Material Name	Material Trade Name	Qty	Principle Use
NA	NA	0	NA

Fuel Details:-

Fuel	Consumption
Diesel	0.025

B. Give the list Products and By Product Details

Product Name	Quantity
NA	0

ByProduct Name	Licence Qty	Installed Qty
NA	0	0

C. Give the list of possible Inter-mediate Products:

Name of Product	Quantity per month
NA	0



12. State daily quantity of water utilized :

Source Consumption	Quantity
Domestic	50000.0
Others(Washing)	15000.0
Others(Quenching)	20000.0

13. A) State the hourly maximum and daily quantity of effluents arising from land/premises for which the application is made:

Generation	Waste Water Generation Quantity
Domestic	1000.0

(B) State how measurement of rate and quantity are carried out: NA

14. State whether storm water drains are kept separate from Industrial / Domestic Effluents? Yes

15. (a)Is domestic effluent allowed to get mixed in industrial effluents? No

16. (a)Describe if any treatment industrial or domestic effluent or one for combined effluent is made. Yes

If yes, state the process of treatment in brief

(b)Is the quantity of effluent emanating either without or after treatment approved by the authority? No

(c)If approved, furnish the authority (Two certified copies to be sent)

(d)If any effluent from any shop/ shops toxic? If so volume of this effluent NA

17. Is there any provision for disposal ?

Name	Status (Already made)	Status (proposed to)
Domestic effluents in Public underground sewer	Yes	No

18. State the area of land used for (a)Above in Hectares

19. Give the quantitative disposal of effluent in liters provided for the places mentioned below

Name	Mode	Mixed
Stream/River	Domestic	NA

20. Is there any provision for equalizing or made holding lagoons of tanks

Name	Mode
Domestic	1000.0

21. Is sufficient land available / can be made available? In case pumping effluent: on lands have to considered. No

22. (a)Give details of composition of Domestic / Industrial / Combined effluent in respect of the Following

Name of Effluent	Effluent before treatment	Effluent after treatment
------------------	---------------------------	--------------------------

Note:-

- 1) Furnish a copy of the analysis report of representative samples carried out by a competent laboratory
- 2) Methods of determination as approved by the Board will be followed for determination of above

mentioned parameters.

- (b)Is the effluent toxic No  
(c)State if the Industrial effluent is having Unpleasant Smell  
(d)Is there any hidden change of temperature exceeding 10\*c at any time No

23. (a)Are facilities available with the applicant for carrying out the following test of the waste waters

Name	Existing	Proposed
------	----------	----------

- (b)If yes, give details of equipments ETP INSTALLED  
24. Has the land/premises, etc., for which the application is made open? Yes  
Highly polluting material : NO  
Toxic Organic Inorganic Microbiological : Re-circulating wells

25. State details for solid waste

Type of Solid Waste	Composition	Quantity	Method of Collection	Method of Disposal
Others	0	9	No	Composting

26. Total investment of Plant/in the factory and the year of investment:- Investment : AS PER BALANCE SHEET  
Year of Investment : 2020

Accompaniments  
Flow sheet of effluents.

Name and Address of the applicant on behalf of : RAMPRAKASH CHADHA,PLOT NO 47, KNOWLEDGE PARK III, GREATER NOIDA

Name and Address of the Firm on behalf of which application is made : RAMPRAKASH CHADHA,PLOT NO 47, KNOWLEDGE PARK III, GREATER NOIDA

## **Explanatory Notes for filing in form and the Annexure**

The notes are given only for those items for which explanations is considered desirable. Other items are self explanatory.

Form-

1. Here mention the name of the owner of the land/premises in case it belongs to other than the applicant industry or factory. If the land/premises belongs to the factory industry, say self.
2. Here mention the date up to which the consent is sought for.
3. Here mention the local name of the river/stream as may be applicable.

Annexure to form-

'Outlet' means the arrangement for discharge of the effluent for which consent is sought for.

'Discharge' means the effluent going out of the outlet.

'Existing' means that which is operation at the time of applying for consent.

'New' means that which will be brought into operation in future.

'Altered' means that which has been modified due to change in quantity and/or quality of discharge arrangement and/or point of discharge etc.

Item 1 : Here give the name of the person who is authorised by the institution/industry/ factory/local body etc. to transact their legal business.

Item 2 : Here give the registered name of the Industry/ Factory/etc. under which the business is carried out.

Item 5 : Here state the concerned institution such as Bureau of Public Enterprises under whose administrative control the Factory/Industry etc., is set up.

Item 6 : Applicable to only those areas which are prohibited areas, such as the Ordinance Factories, Mint, etc.

Item 13(b) : State method of measurement of hourly/daily maximum quantity of effluent i.e. by flow meters, ventury meters, v notch sump measurement estimated etc.

Item 15(a) : If the effluent is treated, give separately the method of treatment and flow diagram of the treatment process.

Item 16(b) : Here mention 'yes' if any other authority such as local body or Government Department as already approved the discharge of effluent either with or without treatment, at the time of establishment of the factory/industry.

Item 19 : Here give the quantity of effluent of different types such as domestic industrial mixed etc. proposed to be or is let into the stream/river, lands, sea, etc., as may be applicable.

Item 22(a) : Analysis to be furnished shall be covered as many Parameters as are expected to be found, in the effluent. If some of the parameters are not expected to be found say not applicable. If some parameters other than those listed under the items are expected, the same be mentioned at the end. The analysis shall be separately furnished for domestic/industrial and combined effluents.

Item 22(b) : Here toxicity meant that which is established by bio-assa studies on fish, as per procedure given in the standard methods.

Item 24 : This item is meant to cover highly polluting substances which do not ordinarily find way in the effluents, but are required to be handled in the premises and which may, by accident, join the effluent in large quantities.

**Common General Information required for consent to operate under Water Pollution (Prevention & Control) Act, 1974 and Air Water Pollution (Prevention & Control) Act, 1981.**

1. (a) Full name of the applicant with address : RAMPRAKASH CHADHA,PLOT NO 47, KNOWLEDGE PARK III, GREATER NOIDA (Tel. No.) -
- (b) Is the firm registered? : YES
- (c) If yes, give the number & date of registration and authority with whom registered. : V-12017/66/2005-DE,2011-12-10
- (d) Full Address of the registered office :
- (e) Names, designation and full address of persons like Partners, Managing Director/Manager etc. : RAMPRAKASH CHADHA PLOT NO 47, KNOWLEDGE PARK III, GREATER NOIDA GAUTAM BUDH NAGAR 8447753522
- (f) Under which category does the industry fall: Large/Medium/Small Scale. : small
2. Full name of the Land/Premises/Institute/Factory/Industry/Local body with address : I T S DENTAL COLLEGE HOSPITAL AND RESEARCH CENTRE  
Address:ITS DENTAL COLLEGE HOSPITAL RESEARCH CENTRE, PLOT NO.47, KNOWLEDGE PARK III, GREATER NOIDA,GAUTAM BUDH NAGAR,201308  
Tel. No.:-  
E-mail :dental.gn@its.edu.in
3. Give revenue /City Survey No. of the land/premises for which the application is made: : District:GREATER NOIDA  
Town/Village:GREATER NOIDA  
City Survey no./Revenue Survey no.:  
Khata No.:  
Area in Hectares:
4. State month and year in which the plant was actually put into commissions or is proposed to be put into commission: : April,2006
5. State the Civil/Military /Defence/industrial Estate etc. under whose administrative jurisdiction the occupiers/industrial plant is situated: : Other  
District:GREATER NOIDA  
Corporation:  
Village Panchayat  
Contonment:  
Defence Deptt:  
State Govt:  
Prohibited areas:  
Others:
6. (a) State whether plant site has been declared as prohibited area: : NO
- (b) If yes, state the name of the Authority and furnish a certified copy of the order under which the area has been declared as prohibited area : -



# UTTAR PRADESH POLLUTION CONTROL BOARD

TC-12V, Vibhuti Khand, Gomti Nagar, Lucknow-226010

Phone :2400852, 2400851, Fax:0651- 2400850

<http://www.uppcb.com/>

## FORM III (See Rule 10) AUTHORISATION

(AUTHORISATION FOR OPERATING A FACILITY FOR COLLECTION, RECEPTION, TREATMENT, STORAGE, TRANSPORT AND DISPOSAL OF BIOMEDICAL WASTES)

- File no. of authorisation and date of issue: No:- 13015563 and Date:-05/08/2021
- M/s I T S DENTAL COLLEGE HOSPITAL AND RESEARCH CENTRE, RAMPRAKASH CHADHA an occupier or operator of the facility located at ITS DENTAL COLLEGE HOSPITAL RESEARCH CENTRE, PLOT NO.47, KNOWLEDGE PARK III, GREATER NOIDA, GAUTAM BUDH NAGAR, 201308 is hereby granted an authorisation for:

Generation, segregation



Collection



Storage



Transportation

Reception

Use

Recycling

Offering for sale

Packaging

Transfer

Treatment or Processing or Conversion

Disposal or destruction

Any other form of handling

- M/s I T S DENTAL COLLEGE HOSPITAL AND RESEARCH CENTRE is hereby authorized for handling of biomedical waste as per the capacity given below:

- Number of beds of HCF: 100
- Number of health care facilities covered by CBMWTF: NA
- Installed treatment and disposal capacity: NA
- Area or distance covered by CBMWTF: NA
- Quantity of Biomedical waste handled, treated or disposed: 8.20 Kg/day

- This authorisation shall be in force for a period of Three Years from the date of issue.

- The authorization shall be valid for till 31/07/2024

- This authorisation is subject to the conditions stated below and to such other conditions as may be specified in the rules for the time being in force under the Environment (Protection) Act, 1986

Date: 05/08/2021  
Place: ITS DENTAL COLLEGE HOSPITAL  
RESEARCH CENTRE, PLOT NO.47,  
KNOWLEDGE PARK III, GREATER  
NOIDA,GAUTAM BUDH NAGAR,201308

Sapna Srivastava  
Regional Officer

**Terms and Conditions of Authorisation**

1. The authorisation shall comply with the provisions of the Environment (Protection) Act, 1986 and the rules made there under.
2. The authorisation or its renewal shall be produced for inspection at the request of an officer authorised by the prescribed authority.
3. The person authorized shall not rent, lend, sell, transfer or otherwise transport the biomedical wastes without obtaining prior permission of the prescribed authority.
4. Any unauthorised change in personnel, equipment or working conditions as mentioned in the application by the person authorised shall constitute a breach of his authorisation.
5. It is the duty of the authorised person to take prior permission of the prescribed authority to close down the facility and such other terms and conditions may be stipulated by the prescribed authority.
6. The Unit will file the renewal application at least 2 months prior to the expiry of this Order

**Specific Conditions:**

1. The Authorization shall comply with provisions of the Environment (Protection) Act 1986 and the rules made there under.
2. The Authorization or its renewal shall be produced for inspection at the request of an officer, Authorized by the prescribed authority.
3. The Authorized person shall not rent, lend, transfer or otherwise transport the bio-Medical waste without obtaining prior permission of the prescribed authority.
4. It is duty of the Authorized person to take prior permission of the Board to close down the facility and such other terms and conditions may be stipulated by the prescribed authority.
5. Any unauthorized change in personnel, equipment or working condition as mentioned in the application by the person authorized shall constitute a breach of this authorization.
6. Bio- Medical waste shall not be mixed with other waste.
7. Bio- Medical waste shall be segregated into containers/ bags at the point of generation in accordance with schedule I. Prior to its storage, transportation, treatment and disposal. The Containers shall be labelled according to schedule IV.
8. No untreated bio medical waste shall be kept stored beyond a period of 48 hours.
9. You shall submit an annual report to the U.P. Pollution Control Board in from IV by 31st January every year. And include information about the categories and quantities of Bio Medical waste during the preceding year.
10. You shall maintain record related to the generation, collection, reception storage, Transportation, treatment and disposal and / or any form of handling of Bio Medical Waste in accordance with rule and guidelines, all records shall be subject to inspection and verification by the Board at any time.
11. It is within the power and functions of U.P. Pollution Control Board to modify/ revoke the terms and conditions of Authorization and issued under the Rule 10 of the Bio-Medical waste Management Rules, 2016.
12. You are hereby directed to comply the stipulated above mentioned conditions and submit the compliance report and steps taken in this regard within a month so that capacity of the facility may be verified failing which the authorization may be revoked and necessary legal proceeding shall be initiated.
13. You will install ETP to treat the leachate generated during collection/ storage of biomedical waste.
14. The Bio medical waste shall not be disposed off in open place in the premises.
15. Compliance of the sub rules 4(c) and (k) of the biomedical rules should be ensured within 3 months time & monthly progress report be sent to this office else authorization would be Revoked without further notice.
16. You are hereby directed to comply the provisions of Bio Medical Waste Management Rules, 2016.
17. This authorization shall be valid subject to the validity of agreement with the Common Bio- Medical Waste Treatment facility. Renewed agreement should be submitted before the expiry of existing agreement.

Memo No.: 13015563

Dated:05/08/2021

**Copy To:**

**Chief Environmental Officer, Circle-1, U.P. Pollution Control Board, Lucknow for information and necessary action.**

**SAPNA SRIVASTAVA** Digitally signed by SAPNA SRIVASTAVA  
Date: 2021.08.06 11:19:37 +05'30'

**Sapna Srivastava**  
**Regional Officer**

PAY VIA CHEQUE/NET  
CASH NOT ACCEPTED

भारतीय गैर न्यायिक

दस  
रुपये

₹.10

TEN  
RUPEES

Rs.10

INDIA

INDIA NON JUDICIAL

उत्तर प्रदेश UTTAR PRADESH

50AE 698526

AGREEMENT

NDA-121

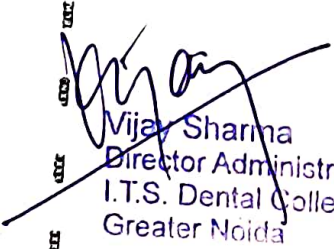
This agreement is made and executed at Meerut on May 17, 2022 and shall be valid only when endorsed through a SEAL of Synergy Waste Management (P) Ltd.

BY AND BETWEEN

Synergy Waste Management (P) Ltd., having its Registered Office at 517-518, 5th Floor, D-Mall, Rohini West, New Delhi - 110085 (CIN No.- U74999DL2005PTC283340), hereinafter referred to as 'Service Provider', duly represented by its Authorized Signatory.

AND

Name of Health Care Establishment (HCE): ITS DENTAL COLLEGE & SURYA HOSPITAL (NOIDA) (Hereinafter referred to as WASTE GENERATOR),

  
Vijay Sharma  
Director Administration  
I.T.S. Dental College,  
Greater Noida

Page 1 of 5





Constitution: **TRUST**

Address of the (HCE) : **47, KNOWLEDGE PARK-III, GREATER NOIDA, GAUTAM BUDDHA NAGAR, UTTAR PRADESH 201308**

Address of the HCE's parent concern (if different from above address) :

**-N.A.-**

Landline : \_\_\_\_\_ Mobile : \_\_\_\_\_

Email : \_\_\_\_\_

Name of the Individual / Proprietor / Partner / **DIRECTOR (ADMIN)**

**MR VIJAY KUMAR** (Mobile No.) **8447753522**

Registration Number : \_\_\_\_\_ / (New Hospital / Clinic / Diagnostic Centre)  
(Registration to be applied).

Landline No. : \_\_\_\_\_ E-mail ID : **dir.admin.dntl@its.edu.in**

Authorized representative of Waste Generator: \_\_\_\_\_

(If different from Doctor)

Designation: \_\_\_\_\_ Contact No. : \_\_\_\_\_

### **RECITALS**

Whereas the Service Provider has been duly authorized by **U. P. Pollution Control Board (UPPCB)** under the provisions of BMW Rule 2016 for providing services of the Collection, Transportation, Storage, Treatment, and Disposal of the Bio-Medical Waste.

And whereas the Waste Generator is desirous to outsource the disposal of its Bio-Medical Waste generated by them and have approached the Service Provider for providing its services at its treatment facility located at

**Subharati Medical College Campus, Subharati Puram, Meerut**

And both the parties are agreed to enter into this agreement on the terms and conditions narrated hereinafter.


NOW THIS INDENTURE WITNESSETH and it is hereby covenant as follows:

### **1. Validity of the Agreement**

This agreement shall remain in force for a period of **1 Year / 0 Months / 0 Days** w.e.f. **Jun 01, 2022** to **May 31, 2023** (both days inclusive), which may be renewed further with mutual consent of both the parties.

However, if the WASTE GENERATOR does not initiate the services within 15 (fifteen) days from execution of this agreement, then this agreement shall become null & void automatically.

If the Waste Generator is a New Hospital / Clinic / Diagnostic Centre and the Registration with the Competent Authority is under process then the Validity of this agreement shall be termed as 'Provisional'. If the Waste Generator fails to submit Registration with competent authority within a period of 3 months, then this agreement shall become null & void. Once the Waste Generator submit its Registration Details, then the Service Provider shall validate this agreement with it's seal.

  
Vijay Sharma  
Director Administration  
I.T.S. Dental College,  
Greater Noida



That this agreement may be renewed further for the period and terms and conditions as agreed in between both of the parties hereto.

**2. Responsibilities of the "Service Provider"**

2.1 That the "Service Provider" shall comply with provisions as stipulated in Schedule-1 of the BMW Rule 2016

2.2 That the "Service Provider" shall collect the segregated bio-medical waste from one designated waste collection point within the premises of WASTE GENERATOR on daily basis except on Sundays & National Holidays.

2.3 That the "Service Provider" shall schedule the timings for collecting the waste in consultation with the GENERATOR.

2.4 That the "Service Provider" shall transport the segregated waste in closed container vehicle to its treatment facility.

2.5 That the "Service Provider" shall not be held liable for any kind of the violation made by the WASTE GENERATOR / or its staff under the Bio-medical Waste Rule 2016.

**3. Responsibilities of the WASTE GENERATOR**

3.1 That the WASTE GENERATOR shall segregate the Bio-Medical waste at the point of generation in accordance with the BMW Rules 2016 and duly amended thereafter.

3.2 That the WASTE GENERATOR shall collect, pack, label and handover the segregated BMW in non-chlorinated bags as stipulated under BMW Rule 2016, which shall be arranged by the "Waste Generator" at its own cost.

3.3 That it shall be the sole responsibility of the Waste Generator to keep the BMW under lock and key so as to protect it from any sort of mishandling before it is handed over to the authorized person of Service Provider.

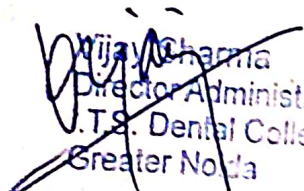
3.4 That the Waste Generator shall be responsible to disinfect and mutilate the sharps and handover it in sealed puncture proof containers to "Service Provider".

3.5 That the WASTE GENERATOR shall take all necessary steps to ensure that the waste is handled without causing any adverse effect to human health and environment.

3.6 That the WASTE GENERATOR shall establish a common secured waste collection end point within its premises for collection, storage of BMW before handing it over to "Service Provider".

3.7 That the WASTE GENERATOR shall designate a "Nodal Officer" to interact with "Service Provider".

3.8 That the WASTE GENERATOR shall apply and obtain necessary authorization from the Prescribed Authority under BMW Rules 2016 and duly amended thereafter and submit its necessary return to the Prescribed Authority from time to time as laid down in the said Rules.

  
Vijay Chandra  
Director Administration  
T.S. Dental College,  
Greater Noida



as conditions as

**4. The Terms of Payment**

4.1 That the WASTE GENERATOR shall pay One Time Non-Refundable Membership Registration Fee of Rs. NIL/-.

4.2 That the WASTE GENERATOR has paid an amount equal to 0.00 months of service charges as refundable/ adjustable interest free security deposit.

4.3 That the Service Provider shall charge Rs.5325.0(Rs.Five Thousand Three Hundred Twenty Five Only.) per month for (Non-Bedded Health Care Facility) .

OR  
Rs. N.A. per month for bedded Health Care facility (No. of Beds-0-)

For the service of collection, transport, treatment & disposal of BMW, subject to the condition of weight limit of 150.0 kg per month. Excess weight shall be charged @Rs.30.0 per kg. The above rates are EXCLUSIVE of GST & any other govt. charges if becomes applicable at any point of time.

That the Waste Generator has made a payment of Rs. NILL/-. (Rupees NILL/-, as advance payment for NILL months.

4.4 That the WASTE GENERATOR undertakes to make the payment through 'Account Payee Cheque or Demand Draft / NEFT' in favour of the Synergy Waste Management (P) Ltd., on or before 7th day of each successive month and thereafter the interest @ 18% for p. a shall be charged by the Service Provider if the payment is not made within the stipulated period.

4.5 That if in any case cheque is bounced besides , actual bank charges, a sum of Rs. 300/- extra will be charged.

4.6 That the jurisdiction of Court in all disputes shall be Delhi to try, entertain & dispose of any dispute between the parties there to.

**5. Limitation of Liability**

That neither party shall be liable to the other for any indirect, special, or consequential damages of any kind, including, but not limited to, loss of profits arising in any manner from this agreement regardless of the foreseeability thereof.


**6. Force Majeure**

That the Parties are not liable for any default or delay in the performance of their respective obligations under the terms of this Agreement; to the extent such default or delay is caused by an event beyond the reasonable control of the either of party, whichever entity is unable to perform (the "Non-Performing Party").

A Force Majeure Event includes but is not limited to, fire, flood, earthquake, elements of nature, acts of war, terrorism, riots, civil disorders, rebellion, strike, lockouts, or any other act or omission of God, government or any other party beyond the Party's control or responsibility. Force Majeure Events shall not give rise to any claim against the other Party; nor shall any default or delay, due to a Force Majeure

**7. Indemnification**

That the WASTE GENERATOR shall indemnify, defend and hold harmless the service provider, its shareholder, officers, directors, employees, representatives, agents and assignees from and against any and all Claims asserted against, imposed upon or incurred, due to, arising out of or relating to any breach by WASTE GENERATOR of any representation, warranty, term, condition or covenant set forth in this Agreement.

 Vijay Sharma  
Director Administration  
I.T.S. Dental College,  
Greater Noida



**8. Termination Clause**

8.1 That both the parties shall be at liberty to terminate this contract by serving a written notice of 1 Month well in advance or alternately compensating the other party by an amount equal to 1 month's service charges.

8.2 Service Provider shall be at liberty to serve the notice of termination of agreement / suspension of services offered at any time to the WASTE GENERATOR if the WASTE GENERATOR fails to make the payment to "Service Provider" within a time frame of Two months from the date on which they became so payable.

8.3 That on termination of this agreement it shall be the responsibility of both the parties to inform prescribed authority as per the provisions of BMW Rules 2016.

THAT I/ WE HAVE READ AND UNDERSTOOD THE ENTIRE CONTENTS OF THIS AGREEMENT AND ASSENT MY/OUR FREE CONSENT TO THE CONTENTS.

THAT BOTH THE PARTIES UNDERTAKE TO REMAIN BOUND BY THE TERMS AND CONDITIONS SET OUT HEREIN ABOVE.

IN WITNESS WHEREOF, THE PARTIES HERE TO HAVE SET THEIR SIGNATURE AND SEAL ON THE DAY AND YEAR MENTIONED HEREIN ABOVE.

**WASTE GENERATOR**

**ITS Dental College & Surya Hospital (Noida)**

Vijay Sharma  
Director Administration  
I.T.S. Dental College,  
Greater Noida



**AUTHORIZED SIGNATORY**

**WITNESS**

Name \_\_\_\_\_

**Signature**

**SERVICE PROVIDER**

**SYNERGY WASTE MANAGEMENT (P)LTD.**



**AUTHORIZED SIGNATORY**

**WITNESS**

Name \_\_\_\_\_

**Signature**



**UTTAR PRADESH POLLUTION CONTROL BOARD**  
**Building. No TC-12V Vibhuti Khand, Gomti Nagar, Lucknow-226010**

Phone:0522-2720828,2720831, Fax:0522-2720764, Email: info@uppcb.com, Website: www.uppcb.com

**CONSENT ORDER**

**Ref No. -**  
**131465/UPPCB/GreaterNoida(UPPCBRO)/CTO/**  
**water/GREATER NOIDA/2021**

**Dated : 02/08/2021**

**To ,**

Shri RAMPRAKASH CHADHA  
M/s I T S DENTAL COLLEGE HOSPITAL AND RESEARCH CENTRE  
ITS Dental College Campus, , Plot No -47, Knowledge Park 3  
GREATER NOIDA

**Sub : Consent under Section 25/26 of The Water (Prevention and control of Pollution) Act, 1974 (as amended) for discharge of effluent to M/s. I T S DENTAL COLLEGE HOSPITAL AND RESEARCH CENTRE**

**Reference Application No :12809364**

**Dated :02/08/2021**

1. For disposal of effluent into water body or drain or land under The Water (Prevention and control of Pollution) Act,1974 as amended (here in after referred as the act ) M/s. I T S DENTAL COLLEGE HOSPITAL AND RESEARCH CENTRE is hereby authorized by the board for discharge of their industrial effluent generated through ETP for irrigation/river through drain and disposal of domestic effluent through septic tank/soak pit subject to general and special conditions mentioned in the annexure ,in reference to their foresaid application .
2. This consent is valid for the period from 01/08/2021 to 31/07/2024 .
3. In spite of the conditions and provisions mentioned in this consent order UP Pollution Control Board reserves its right and powers to reconsider/amend any or all conditions under section 27(2) of the Water (Prevention and Control of Pollution) Act, 1974 as amended .

This consent is being issued with the permission of competent authority .

**For and on behalf of U.P. Pollution Control Board**  
**SAPNA SRIVASTAVA** Digitally signed by SAPNA SRIVASTAVA  
Date: 2021.08.03 12:18:43 +05'30'  
**Regional Officer**

**Enclosed : As above**  
**(condition of consent):**

Copy to: Chief Environmental Officer – 1, U.P. Pollution Control Board, Lucknow

**SAPNA SRIVASTAVA** Digitally signed by SAPNA SRIVASTAVA  
Date: 2021.08.03 12:18:58 +05'30'  
**Regional Officer**

## U.P. POLLUTION CONTROL BOARD, LUCKNOW

### Annexure to Consent issued to M/s.I T S DENTAL COLLEGE HOSPITAL AND RESEARCH CENTRE vide

Consent Order No. 12809364/ Water

Dated : 02/08/2021

#### CONDITIONS OF CONSENT

1. This consent is valid only for the approved production capacity of Educational Institute and R & D Lab.
2. The quantity of maximum daily effluent discharge should not be more than the following :

<b>Effluent Discharge Details</b>			
<b>S.No</b>	<b>Kind of Effluent</b>	<b>Maximum daily discharge,KL/day</b>	<b>Treatment facility and discharge point</b>
1	Domestic	10.0 KLD (GNIDA STP)	Septic Tank
2	Industrial	4.0 KLD	ETP

3. Arrangement should be made for collection of water used in process and domestic effluent separately in closed water supply system. The treated domestic and industrial effluent if discharged outside the premises, if meets at the end of final discharge point, arrangement should be made for measurement of effluent and for collecting its sample. Except the effluent informed in the application for consent no other effluent should enter in the said arrangements for collection of effluent. It should also be ensured that domestic effluent should not be discharged in storm water drain .
- 4(a) The domestic effluent should be treated in treatment plant so that the should be in conformity with the following norms dated treated effluent .

<b>Domestic Effluent</b>		
<b>S.No</b>	<b>Parameter</b>	<b>Standard</b>
1	Quantity of Discharge	As per norms

- 4(b). The industrial effluent should be treated in treatment plant so that the treated effluent should be in conformity with the following norms. .

<b>Industrial Effluent</b>		
<b>S.No</b>	<b>Parameter</b>	<b>Standard</b>
1	Total Suspended Solids	100 mg/l
2	BOD	30 mg/l
3	COD	250 mg/l
4	Oil & Grease	10 mg/l

5. Effluent generated in all the processes, bleed water, cooling effluent and the effluent generated from washing of floor and equipments etc should be treated before its disposal with treated industrial effluent so that it should be according to the norms prescribed under The Environment (Protection) Act,1986 or otherwise mandatory .
6. The other pollutant for which norms have not been prescribed, the same should not be more than the norms prescribed for the water used in manufacturing process of the industry .
7. The method for collecting industrial and domestic effluent and its analysis should be as per legal Indian standards and its subsequent amendments/standards prescribed under The Environment (Protection) Act, 1986.
8. The treated domestic and industrial effluent be mixed (as per the provisions of Condition No. 2) and disposed of on one disposal point. This common effluent disposal point should have arrangement for flow meter/V Notch for measuring effluent and its log book be maintained .
9. The Unit will file the renewal application at least 2 months prior to the expiry of this Order.

#### Specific Conditions:

1. It is NOT ALLOWED to dig BORE-WELL in the UNIT without UPGWD NOC. In case of violation, Environmental Compensation shall be imposed and legal proceedings will be initiated against the industry. If the industry is setting up a bore-well for ground water use, then in compliance with the Uttar Pradesh Ground Water Act, 2019 from the UP Ground Water Department Be sure to obtain permission and send it to the office within three months. Otherwise, this consent order will be automatically considered revoked.
2. Industry shall ensure adequate plantation and green belt within its premises. Green cover shall be in compliance of approved map from concerned Authority.
3. Industry shall comply with various Waste Management Rules as notified by MoEf&CC i.e. Plastic Waste Management Rules, 2016, Solid Waste Management Rules, 2016, Hazardous and Other Wastes (Management and Transboundary) Rules, 2016, E-waste (Management) Rules, 2016, Construction and Demolition Waste Management Rules, 2016
4. Industry shall submit annual returns as per above mentioned rules. Also, Environmental Statement in prescribed form as per Rule 14 of Environment (Protection) Act, 1986.
5. This consent is valid only for products and quantity mentioned above. Industry shall obtain prior approval before making any modification in product/process/discharge/plant machinery failing which consent would be deemed void.
6. Industry shall make rain water harvesting on the premises as per map approved by concerned Authority. Pre-monsoon and Post- monsoon maintenance of rain water harvesting pit shall be done annually.
7. Industry shall abide by directions given by Hon'ble Supreme Court, High Court, National Green Tribunals, Central Pollution Control Board and Uttar Pradesh Pollution Control Board for protection and safeguard of environment from time to time.
8. Industry shall develop green belt in accordance with Government Order 07/55-02-2018/09(writ)/2016 dated 26/02/2018 and UPPCB Office order issued vide letter no. H16405/220/2018/02 dated 16/02/2018
9. Industry shall ensure carbon offsetting as per Government Order (Environment Department) issued vide letter no. H17259/ 183/55-2-2018/09(writ)/2016 dated 15.03.2018
10. Industry shall ensure compliance of CPCB Directions dated 02.07.2019 issued u/s 18(1)(b) of Air Act, 1981 to SPCBs of NCR, regarding conversion of industrial units in NCR to PNG.

**Issued with the permission of competent authority .**

**For and on behalf of U.P. Pollution Control Board .**

**SAPNA SRIVASTAVA** Digitally signed by SAPNA SRIVASTAVA  
Date: 2021.08.03 12:19:17 +05'30'

**Regional Officer**



S. No. 0135

Date: 12-08-2023

## CERTIFICATE OF E-WASTE RECYCLING

This is to certify that green star e-waste recycling

from

ITS Dental College Hospital & Research Centre

(Unit of Durga Charitable Society), KP-III, UP-201310

has been disposed off by or R2 Certified Facility in an environment friendly manner

E-Waste: **550**KG

For **Green Star Recycling**



Authorised Signatory

E-Waste Management

Secured Date / Destruction

Lamp Recycling

Skill Development

Authorisation No. : 9/A-5/E-WASTE-1486/2022

Registered Office : Khasra No. 394, Village-Achchharonda, Industrial Area, Meerut-250003, UP

Mob.: +91 9958296755 E-mail : info@greenstarewaste.com Web. : www.greenstarewaste.com





UTTAR PRADESH POLLUTION CONTROL BOARD  
T.C. 12V, VIBHUTI KHAND, GOMTI NAGAR, LUCKNOW

Ref:.....

Dated:.....

**AUTHORISATION**

(Authorisation under Bio-Medical Waste Management Rules, 2016 for operating a facility for generation, collection, reception, treatment, storage, transport and disposal of biomedical waste)


1. Number of Authorisation and date of issue: 1A) 10 MW-817 27-28-2019
2. Mr. Neeraj Aggarwal, Director of M/s Synergy Waste Management (P) Ltd., Subharti Medical College Campus, Subharti Puram, Delhi Haridwar Bypass Road, Meerut (CBMWTF) is hereby granted an authorisation for;
  - (i) Generation, segregation
  - (ii) Collection (Temporary)
  - (iii) Storage (Temporary)
  - (iv) Packaging
  - (v) Disposal (Through CBMWTF)
3. Director of M/s Synergy Waste Management (P) Ltd., Subharti Medical College Campus, Subharti Puram, Delhi Haridwar Bypass Road, Meerut (CBMWTF) is hereby Authorised for handling of biomedical waste as per the capacity given below:
  - (i) Number of Beds of HCF.... ----
  - (ii) Number healthcare facilities covered by CBMWTF 1629
  - (iii) Installed treatment and disposal capacity 19800 Kg/day
  - (iv) Area or distance covered by CBMWTF Radius of 150 Km.
  - (v) Quantity of Biomedical Waste handled, treated or disposed (As Below)

Type of Waste Category	Quantity permitted for Handling
Yellow	2785 Kg/ day (Approx)
Red	663 Kg/ day (Approx)
White (Translucent)	10 Kg/day (Approx)
Blue	200 Kg/ day (Approx)

4. This authorisation shall be in force for a period up to **31-12-2019** from the date of issue.
5. This authorisation is subject to the conditions stated below and to such other conditions as may be specified in the rules for the time being in force under the Environment (Protection) Act, 1986.

**TERM AND CONDITIONS OF AUTHORISATION**

1. The Authorisation shall comply with provisions of the Environment (Protection) Act, 1986 and the rules made there under.
2. The Authorisation or its renewal shall be produced for inspection at the request of an officer Authorised by the prescribed authority.
3. The Authorised person shall not rent, lend, transfer or otherwise transport the Bio-Medical waste without obtaining prior permission of the prescribed authority.
4. Any unauthorised change in personal, equipment or working conditions as mentioned in the application by the person authorized shall constitute a breach of this authorization.
5. It is the duty of the Authorised person to take prior permission of the prescribed authority to close down the facility and such other terms and conditions may be stipulated by the prescribed authority.

  
Member Secretary



उत्तर प्रदेश प्रदूषण नियंत्रण बोर्ड  
UTTAR PRADESH POLLUTION CONTROL BOARD

संदर्भ सं० H14044 / C-3 / Bmw-8117

दिनांक..... 27-12-17

To,

Director,  
M/s Synergy Waste Management (P) Ltd.,  
Subharti Medical College Campus, Subharti Puram,  
Delhi Haridwar Bypass Road,  
Meerut

Sub: Authorization for operating facility for ( Collection, Reception, treatment, storage, transport and disposal of biomedical waste) under the provision of Bio-Medical Waste Management Rules, 2016.

Sir,

With reference to your application received in this office on date. 04.09.2017 an Authorization No... (A) Bmw-8117 dated... 27.12.17.....as prescribed under rule 10 of the Bio Medical Waste Management Rules 2016.


You are requested to strictly comply with all conditions and send monthly progress report to the Board, The authorization is valid for a period up to 31-12-2019 from the date of issue.

Yours Sincerely,

  
(Paras Nath)

Environmental Engineer, Incharge (C-3)

Copy to: The Regional Officer, U.P. Pollution Control Board, Meerut for information and necessary action and with direction to send the point wise compliance report at the earliest.

  
Environmental Engineer, Incharge (C-3)



**Shiva Global Environmental Pvt. Ltd**  
**Total Water Management**

G-42, Ground Floor, Dilshad Colony, New Delhi - 95 (INDIA)

Telephone. : + 91 - 11-43000778, 45872472, 47072472

E-mail: [shivaglobalenviro@gmail.com](mailto:shivaglobalenviro@gmail.com), Website: [www.shivaglobalenviro.com](http://www.shivaglobalenviro.com)

Ref. No. SGEPL/ITS/ETP-2.0 KLPB/2018-19

Date: 31-12-2019

To

M/s ITS College

47, Knowledge Park-III, Greater Noida-201308  
Distt-Gautam Budh Nagar, Uttar Pradesh, India

Sub: Completion Certificate for Effluent Treatment Plant for Lab & OT Waste Water for Proposed Hospital

i) Quotation dated **15-04-2019** from **Annexure A to H**

ii) Your Order dated **01-08-2019**

iii) Project Complete dated **31-12-2019**

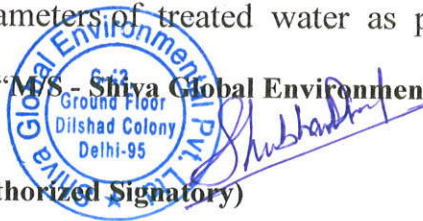
Gentlemen,

With reference to above, the Project Completion Certificate for Effluent Treatment Plant for the Hospital (M/s ITS College), is hereby issued, subject to the following conditions.

- The ETP comprises of Lab/OT Waste Water includes screening OGS Chamber, Collection Tank, Clarisettler, dual media pressure sand filtration was found constructed. The treated water will be used for gardening and flushing, as per the feasibility report.
- The ETP as proposed and constructed appears to be in order.
- Test Results of the treated effluent shall be obtained periodically from the date of commissioning of ETP
- Reuse of the treated water shall be as per the UPPCB's norms only. If required, necessary arrangement shall be provided to bring down the parameters of treated water as per the UPPCB's norms.

For "M/s - Shiva Global Environmental Pvt. Ltd"

(Authorized Signatory)



Manufacturer & Suppliers of:-

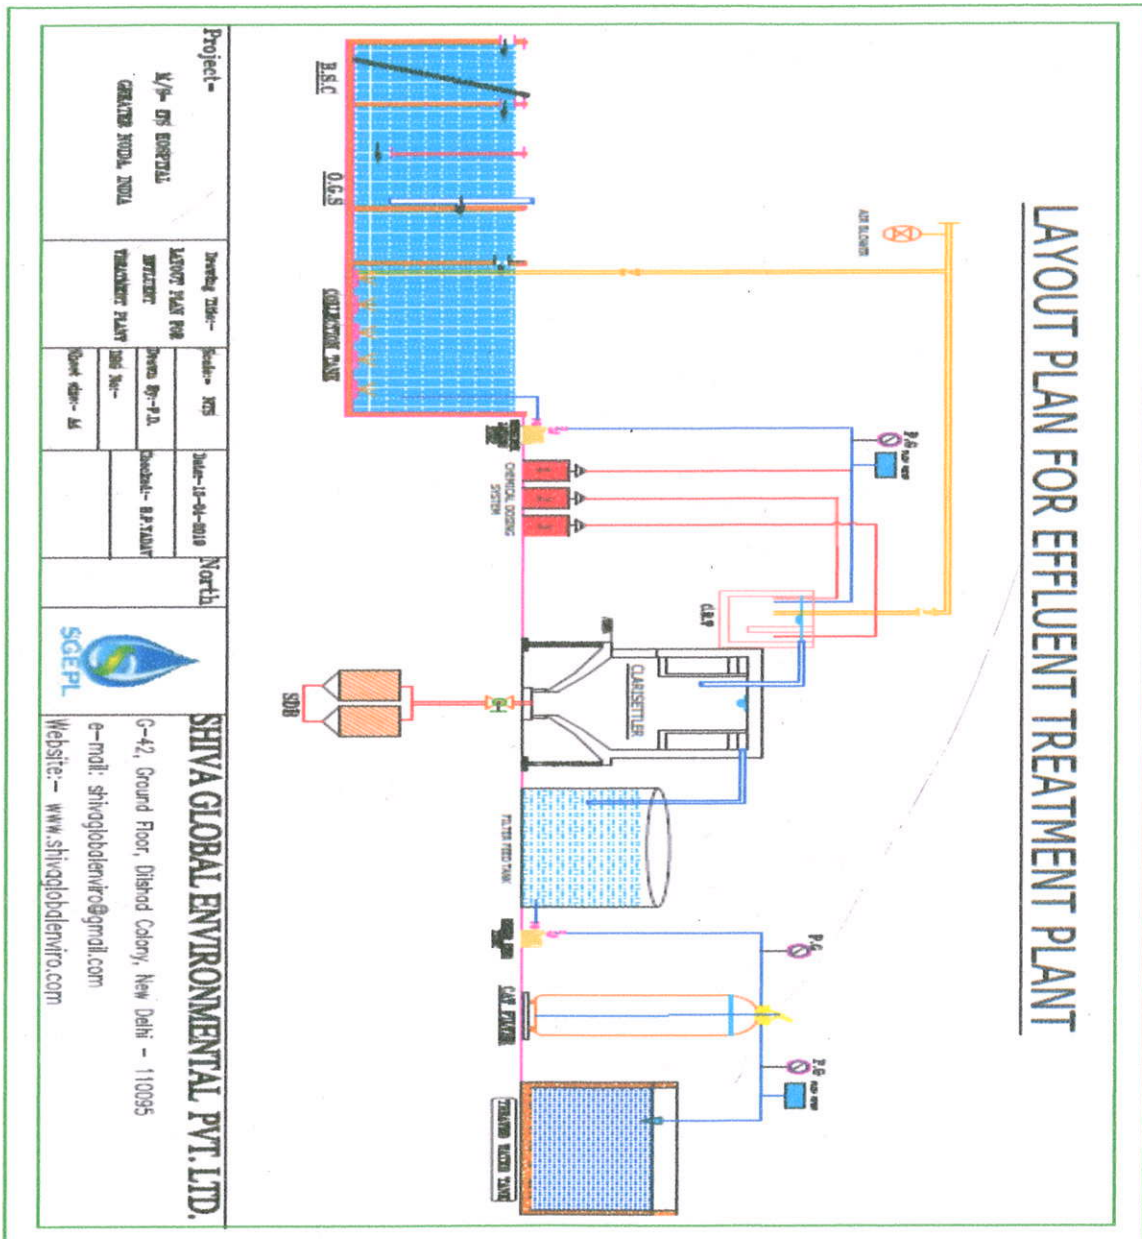
Water Treatment, Waste Water Treatment Plants, Chemicals & Spares  
Pioneer in Waste Water Recycling System

An ISO 9001-2015 and 14001-2015, 18001-2007, MSME & NSIC Certified Company



The process flow diagram of the Effluent Treatment Plant is shown in Figure-2.

**Figure-2: Process Flow Diagram – ETP**





## ANNEXURE-II

### METHODOLOGY & TREATMENT PHYLOSOPHY

The Effluent generated from LAB/OT of Hospital **M/s ITS COLLEGE, GREATHER NOIDA, U.P. INDIA**, consists of organic wastes and the different sections of Effluent generated. The treatment philosophy of the ETP is in accordance with the Physio-Chem process followed by tertiary Systems.

The effluent is mainly collected from different sources of the waste generation points of the unit and forwarded to Equalization Tank. It is a batch process, The Effluent Treatment Plant (ETP) work to average 2.0 KL per batch.

The Effluents Treatment Philosophy is in accordance with the norms & compliance of **The Uttar Pradesh Pollution Control Board (as governed by UPPCB)** which is suggested to meet the permissible limit as per the prescribed norms, This section describes the treatment units along with the process design of technical specifications put forward for the installed Treatment Plant at the unit premises of **M/s ITS COLLEGE, GREATHER NOIDA, U.P. INDIA** The Process Flow is described below for easy understanding.

The **Project Report** is a detailed description of the treatment units for Effluent Treatment Plant proposed with a Process Flow Sheets. The proposed plant incorporates Pre-treatment, Chemical treatment and Sand filtration system for treating effluent and Sludge Handling units. The chemical process is needed to remove Mainly COD and TSS.



*Shubham Singh*